



NORTH LAKE TAHOE FIRE PROTECTION DISTRICT

866 Oriole Way – Incline Village, NV 89451-9439
 (775) 831-0351 Fax (775) 831-2072 www.nltfpd.org

Mobile Food Truck Application

Applicant Name: _____ Food Truck Name: _____

Contact Cell Phone: _____ Contact Email: _____

Billing Street Address: _____

Billing City/State/Zip Code: _____

Scope of Work: _____

Date & Hours of Event in Incline Village/Crystal Bay: _____




Following the Adopted 2018 IFC (NLTFPD Resolution 18-1), A permit is required for mobile food preparation vehicles equipped with appliances that produce smoke or grease laden vapors. If applicable, please acknowledge the following requirements:

Adopted 2018 IFC, Nevada State Fire Marshal, and NFPA Standards	Initial
A permit is required from NLTFPD <i>prior</i> to operating in Incline Village/Crystal Bay. The permit can only be issued after a site inspection with the Fire Inspector.	
A 2.5-gallon Class K Extinguisher will need to be provided or two 1.5-gallon Class K extinguishers (Section 906.4). Extinguishers shall be placed in a conspicuous location, unobstructed, and securely anchored (Section 906.4). Extinguisher shall be currently serviced by contractor with State Fire Marshal.	
Cooking equipment that produces grease laden vapors shall be provided with a kitchen exhaust hood, in accordance with Section 607 (Section 319). Kitchen hoods shall be cleaned in accordance with Section 603.3.	
Cooking equipment producing grease laden vapors shall be protected by an automatic fire extinguishing system, following Section 906.4 (Section 319), following applicable NFPA Standards. The system shall be currently serviced by a licensed contractor with the State Fire Marshal.	
Gas cooking appliances shall be secured in place and connected to fuel-supply piping with an appliance connector complying with ANSI Z21.69/CSA 6.16 . The connector shall be installed in accordance with the manufacturer’s specifications. Appliances shall be limited by movement using restraining devices installed in accordance with the connector’s and appliance’s manufacturer’s specifications (Section 319).	
LP-Gas Containers installed on the vehicle and Fuel-Gas Piping shall be Inspected Annually by an Approved Inspection Agency or a company that is registered with the USDOT to requalify LP-Gas Cylinders (Section 319).	
Metallic Storage Tanks for oil within mobile food trucks shall be listed under UL 80 or UL 142 and installed in accordance with manufacturer’s specifications.	
Non-Metallic Storage Tanks for oil shall be listed for use, including during maximum temperatures of use, and not exceeding 200 gallons.	
Normal and emergency venting shall be provided for cooking oil storage tanks (Section 319).	
LP-Gas Containers shall (Section 319): (a) not exceed 200 lbs.; (b) be securely mounted and restrained to prevent movement; (c) have piping, including valves and fittings, that is adequately protected from tampering and damage; (d) have an LP-gas alarm system installed according to manufacturer’s specifications.	

Applicant Signature _____ Date _____



FOOD TRUCK SAFETY

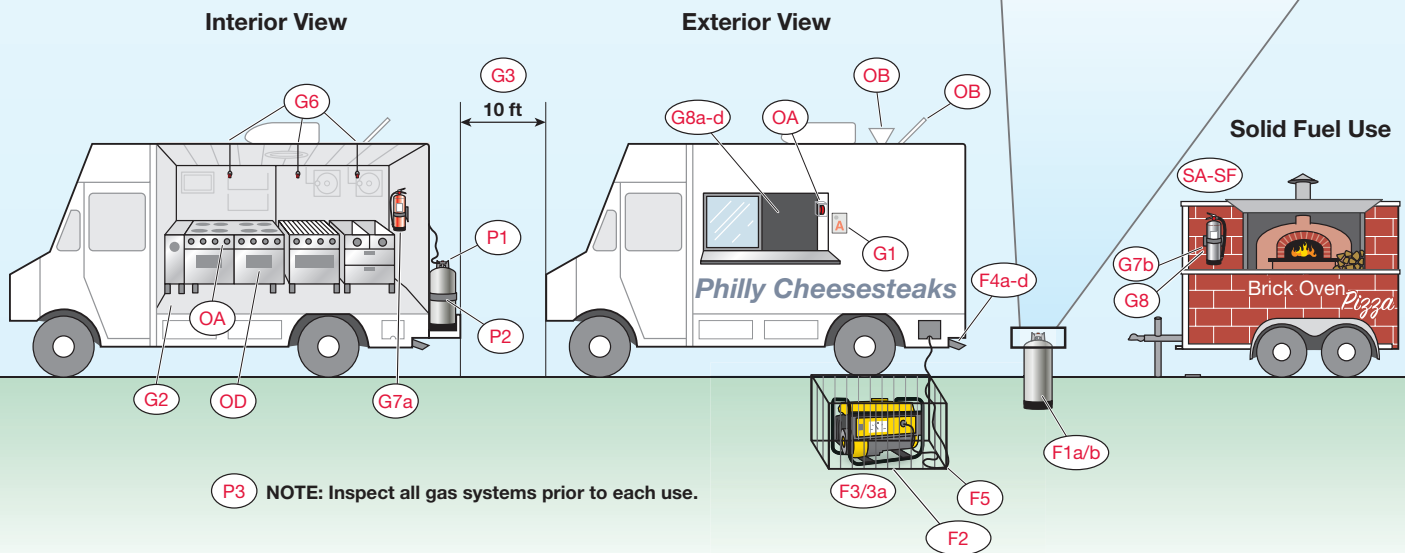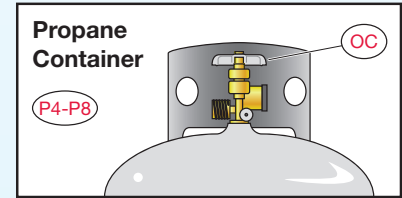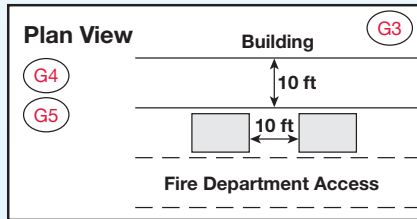

NFPA code references are provided at the end of each item. The red keys correspond to the NFPA food truck safety diagram. For more detailed information, see NFPA 1 and Chapter 17 in NFPA 96.

General Safety Checklist

- Obtain license or permits from the local authorities. [1:1.12.8(a)] **G1**
- Ensure there is no public seating within the mobile food truck. [1:50.8.3.2] **G2**
- Check that there is a clearance of at least 10 ft away from buildings, structures, vehicles, and any combustible materials. [96:17.2] **G3**
- Verify fire department vehicular access is provided for fire lanes and access roads. [1:18.2.4] **G4**
- Ensure clearance is provided for the fire department to access fire hydrants and access fire department connections. [1:13.1.4; 1:13.1.5] **G5**
- Check that appliances using combustible media are protected by an approved fire extinguishing system. [96:10.1.2] **G6**
- Verify portable fire extinguishers have been selected and installed in kitchen cooking areas in accordance with NFPA 10. [96:10.9] **G7a**
- Where cooking appliances that use solid fuel, such as charcoal or wood, produce grease-laden vapors, make sure the appliances are protected by listed fire-extinguishing equipment. [96:15.7.1] **G7b**
- Ensure that workers are trained in the following: [96:17.10]: **G8**
 - Proper use of portable fire extinguishers and extinguishing systems [96:17.10.1(1)] **G8a**
 - Proper method of shutting off fuel sources [96:17.10.1(2)] **G8b**
 - Proper procedure for notifying the local fire department [96:17.10.1(1)] **G8c**
 - Proper procedure for how to perform simple leak test on gas connections [96:17.10.1(5)] **G8d**



FOOD TRUCK SAFETY CONTINUED

Fuel & Power Sources Checklist

- Verify that fuel tanks are filled to the capacity needed for uninterrupted operation during normal operating hours. [1:10.14.11.1 for carnivals only] **F1a**
- Ensure that refueling is conducted only during non-operating hours. [96:17.8.3] **F1b**
- Check that any engine-driven source of power is separated from the public by barriers, such as physical guards, fencing, or enclosures. [96:17.5.2.2] **F2**
- Ensure that any engine-driven source of power is shut down prior to refueling from a portable container. [1:10.15.4] **F3**
- Check that surfaces of engine-driven source of power are cool to the touch prior to refueling from a portable container. **F3a**
- Make sure that exhaust from engine-driven source of power complies with the following: **F4**
 - At least 12 ft in all directions from openings and air intakes [96:17.5.2.3(1)] **F4a**
 - At least 12 ft from every means of egress [96:B.13] **F4b**
 - Directed away from all buildings [96:17.5.2.3(2)] **F4c**
 - Directed away from all other cooking vehicles and operations [96:17.5.2.3(3)] **F4d**
- Ensure that all electrical appliances, fixtures, equipment, and wiring complies with the NFPA 70® [96:17.8.1] **F5**

Propane System Integrity Checklist

- Check that the main shutoff valve on all gas containers is readily accessible. [58:6.26.4.1(3)] **P1**
- Ensure that portable gas containers are in the upright position and secured to prevent tipping over. [58:6.26.3.4] **P2**
- Inspect gas systems prior to each use. [96:17.7.2.3] **P3**
- Perform leak testing on all new gas connections of the gas system. [58:6.16; 58:6.17] **P4**
- Perform leak testing on all gas connections affected by replacement of an exchangeable container. [58:6.16; 58:6.17] **P5**
- Document leak testing and make documentation available for review by the authorized official. [58:6.26.5.1(M)] **P6**
- Ensure that on gas system piping, a flexible connector is installed between the regulator outlet and the fixed piping system. [58:6.26.5.1(B)] **P7**
- Where a gas detection system is installed, ensure that it is tested monthly. [96:17.7.2.2] **P8**

Operational Safety Checklist

- Do not leave cooking equipment unattended while it is still hot. (This is the leading cause of home structure fires and home fire injuries.) **OA**

- Operate cooking equipment only when all windows, service hatches, and ventilation sources are fully opened. [96:12.1.1] **OB**
- Close gas supply piping valves and gas container valves when equipment is not in use. [58:6.26.8.3] **OC**
- Keep cooking equipment, including the cooking ventilation system, clean by regularly removing grease. [96:12.4] **OD**

Solid Fuel Safety Checklist (Where Wood, Charcoal, Or Other Solid Fuel Is Used)

- Fuel is not stored above any heat-producing appliance or vent. [96:15.9.2.2] **SA**
- Fuel is not stored closer than 3 ft to any cooking appliance. [96:15.9.2.2] **SB**
- Fuel is not stored near any combustible flammable liquids, ignition sources, chemicals, and food supplies and packaged goods. [96:15.9.2.7] **SC**
- Fuel is not stored in the path of the ash removal or near removed ashes. [96:15.9.2.4] **SD**
- Ash, cinders, and other fire debris should be removed from the firebox at regular intervals and at least once a day. [96:15.9.3.6.1] **SE**
- Removed ashes, cinders, and other removed fire debris should be placed in a closed, metal container. [96:15.9.3.8.1] **SF**

Learn More

- ▶ Get free digital access to NFPA codes and standards at: nfpa.org/docinfo
- ▶ Read the latest news and updates at: nfpa.org/foodtrucksafety
- ▶ Review the following and other NFPA resources at: nfpa.org
 - NFPA 1, *Fire Code*, 2021 Edition
 - *NFPA 1 Fire Code Handbook*, 2021 Edition
 - NFPA 10, *Standard for Portable Fire Extinguishers*, 2018 Edition
 - NFPA 58, *Liquefied Petroleum Gas Code*, 2020 Edition
 - *LP-Gas Code Handbook*, 2020 Edition
 - NFPA 70®, *National Electrical Code*®, 2020 Edition
 - *National Electrical Code*® *Handbook*, 2020 Edition
 - NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*, 2021 Edition
 - NFPA 96: *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations Handbook*, 2017 Edition

